




**2013 CPC 718.3 & 720.0**

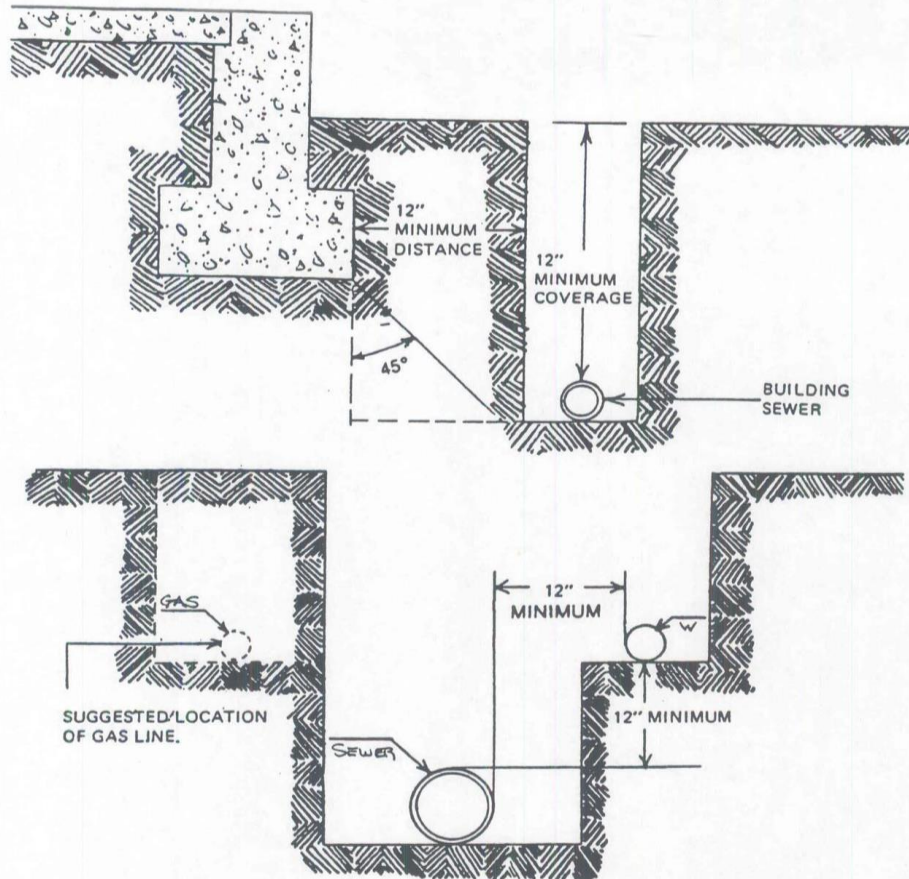

**Sewer and Water Pipes**

Building sewers or drainage piping of clay or materials which are not approved for use within a building shall not be run or laid in the same trench as the water pipes unless **both** of the following requirements are met:

- (1) The bottom of the water pipe, at all points, shall be at least twelve (12) inches (0.3 m) above the top of the sewer or drain line.
- (2) The water pipe shall be placed on a solid shelf excavated at one side of the common trench with a minimum clear horizontal distance of at least twelve (12) inches (0.3 m) from the sewer or drainline.

CPC 718.3 & 720.0